

*cancel
11/19/00*

10

12

Fig. 2

14

16

18

20


22

26

Fig. 2

24

FIG. 1

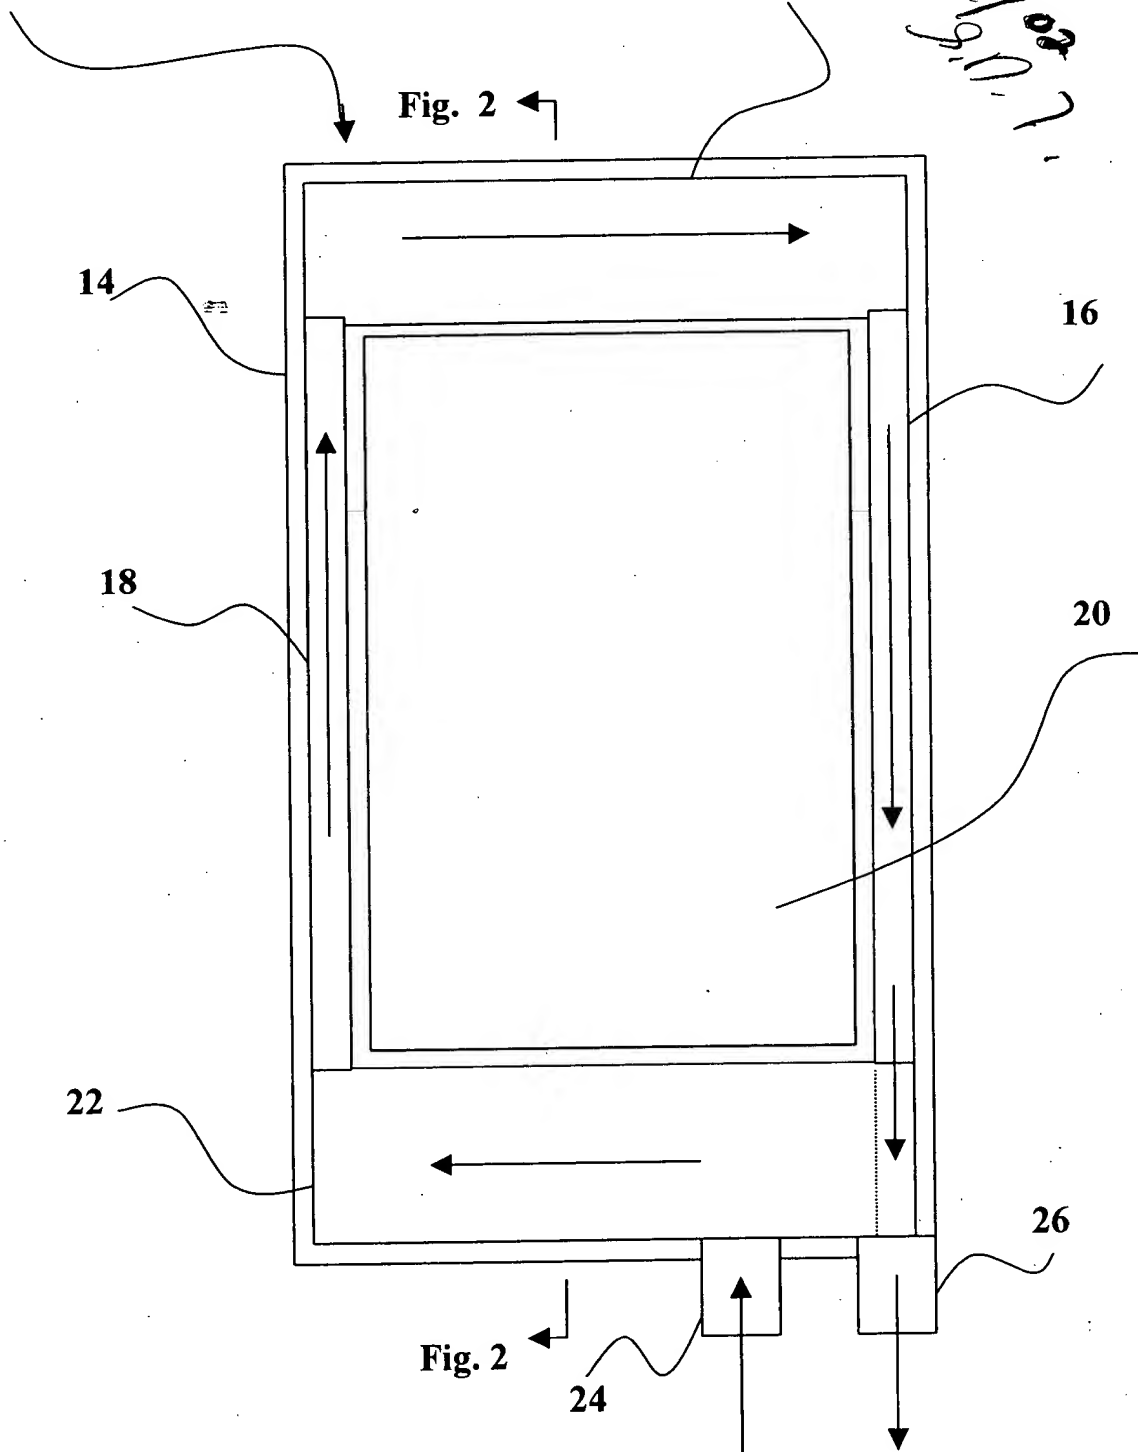

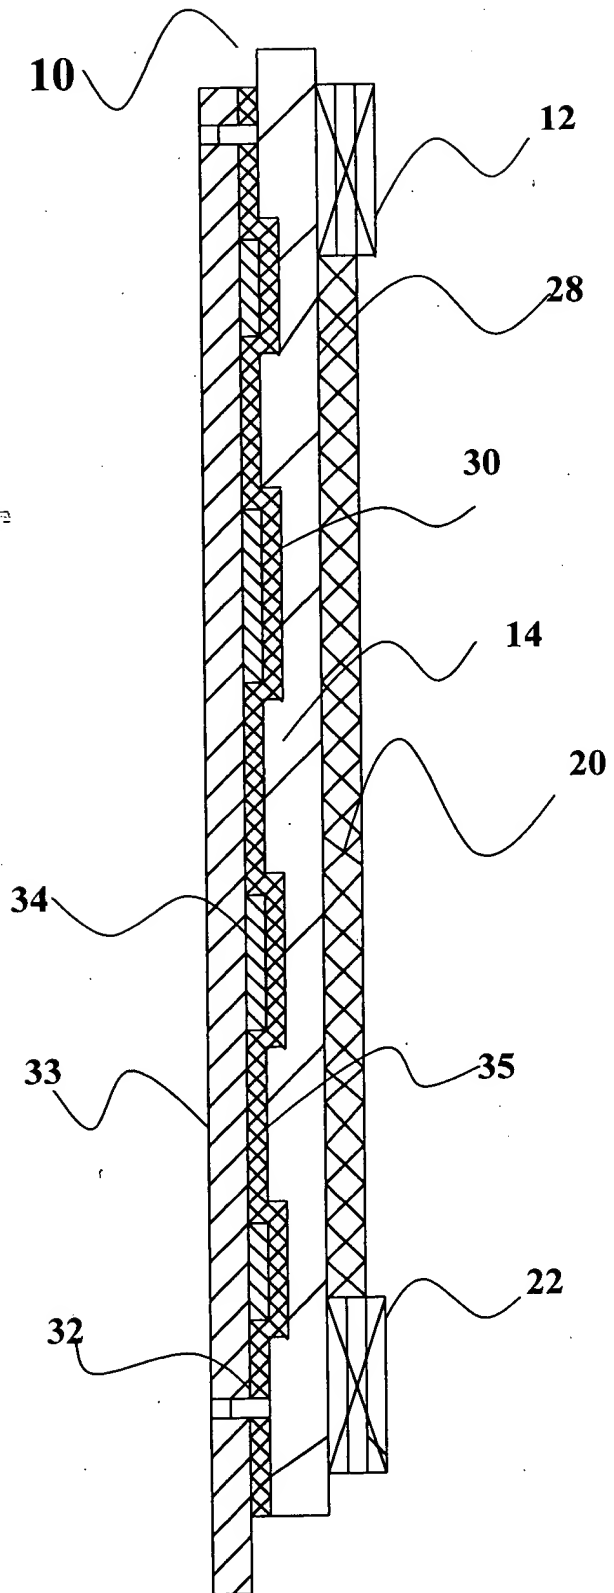
[illegible]

FIG. 2

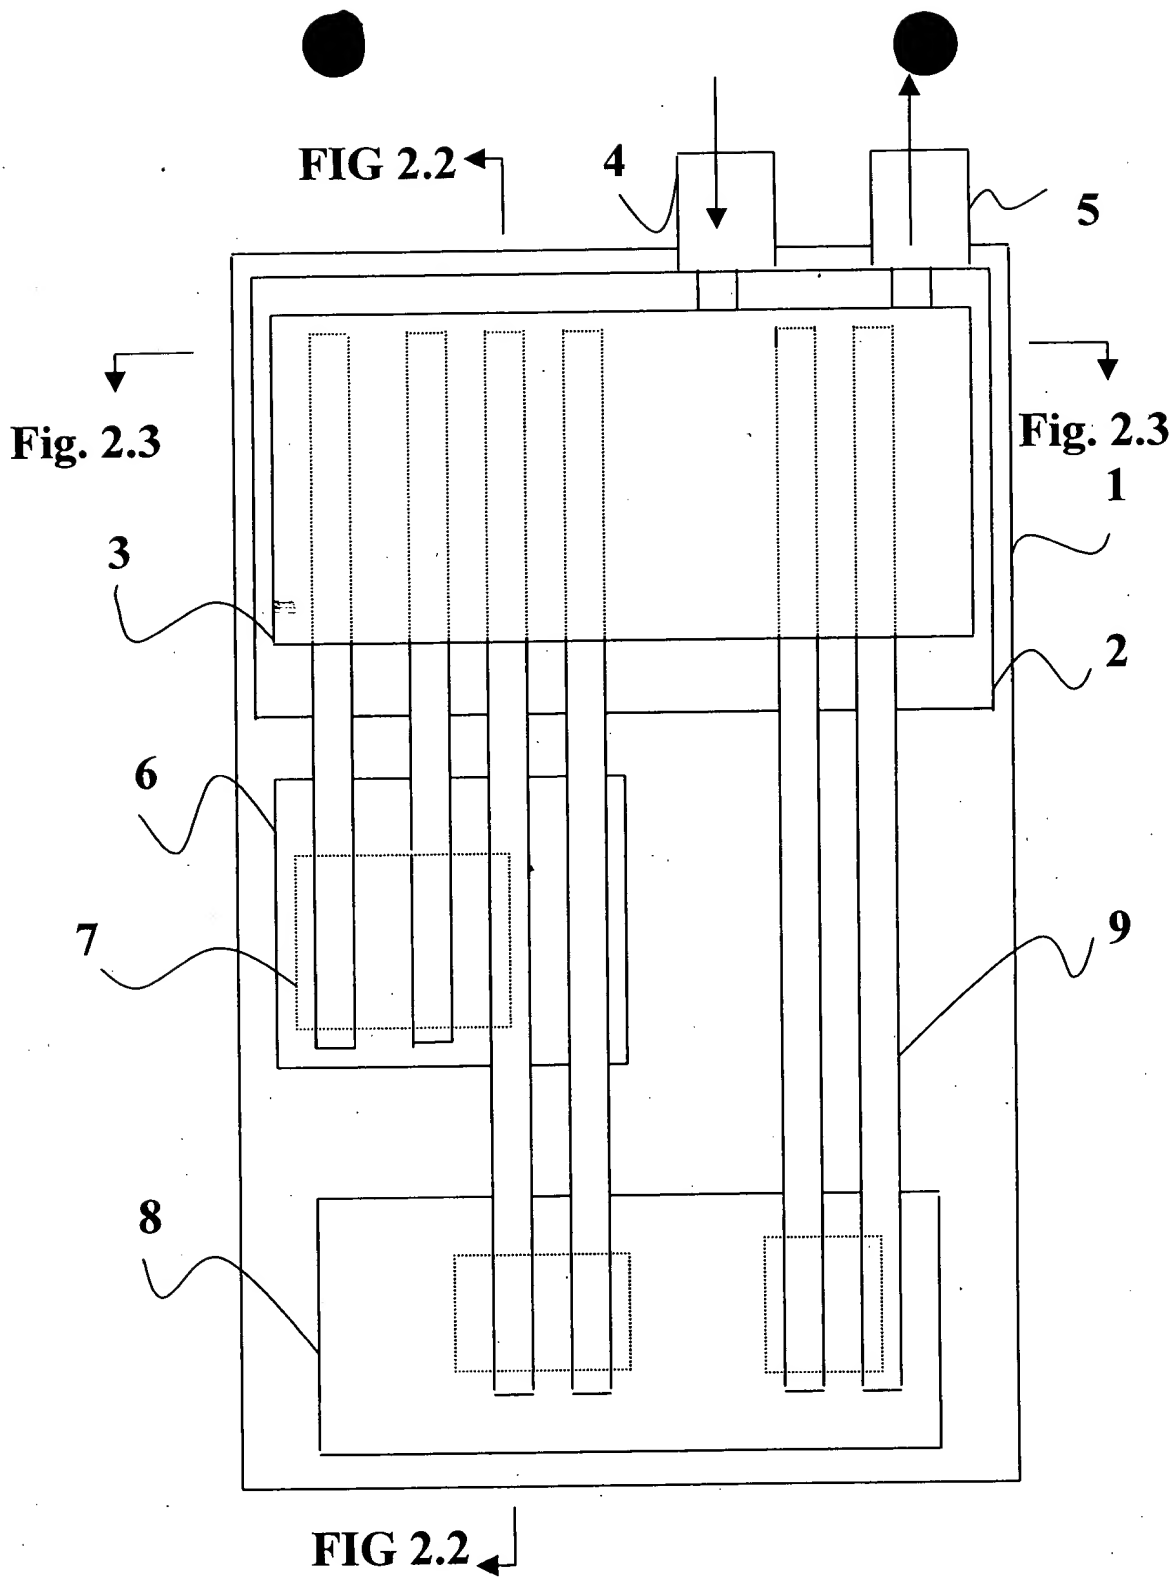


FIG. 2.1

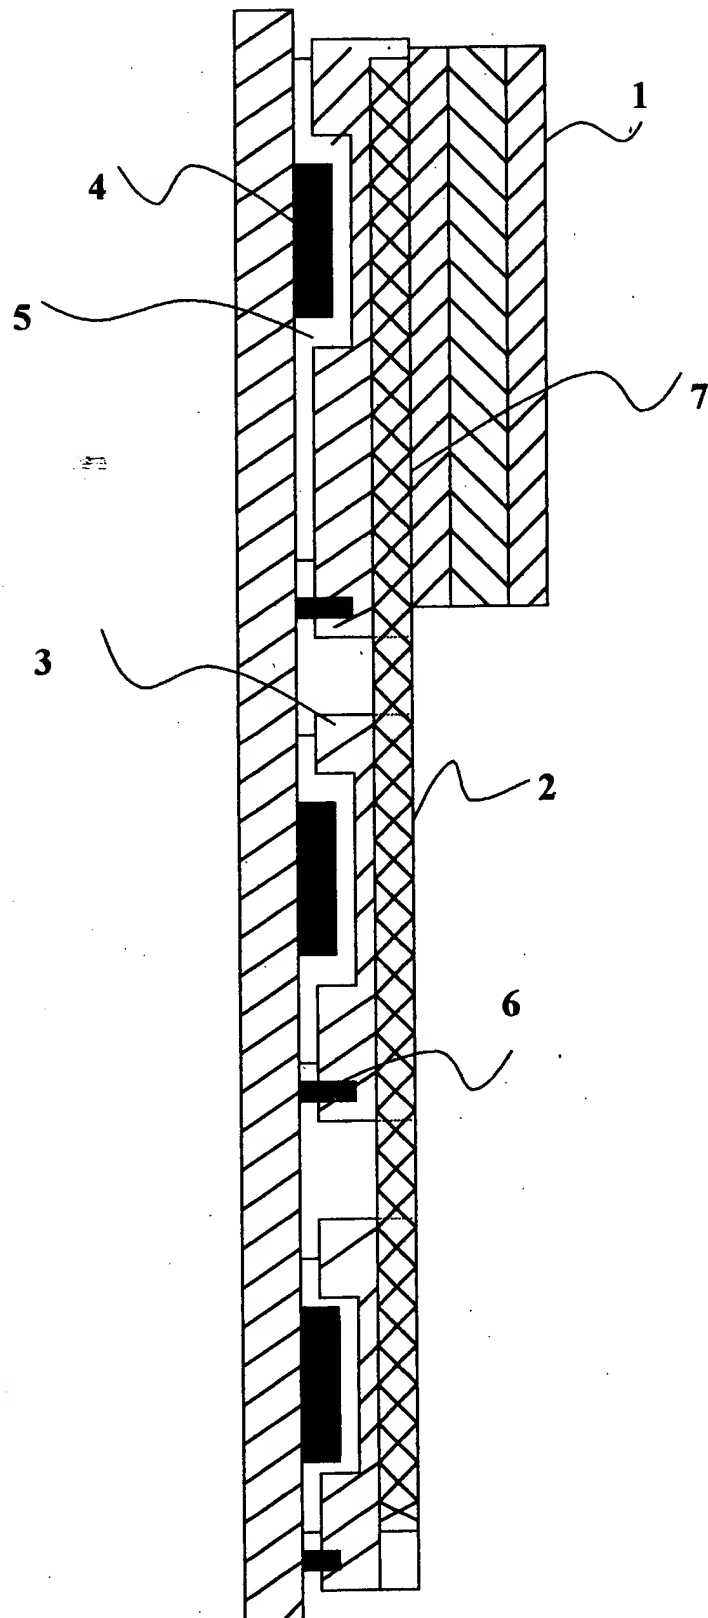


FIG. 2.2

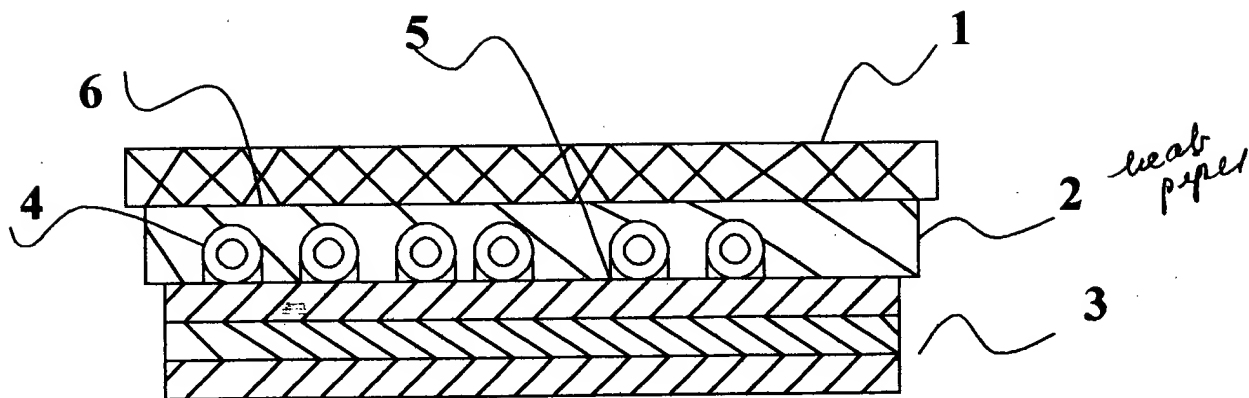


Fig. 2.3

CONFIDENTIAL

100

**SELECTING THERMALLY CONDUCTIVE
COLD PLATE BASE**

102

**SELECTING HEAT PIPE THERMAL PLANE OR
INDIVIDUAL HEAT PIPES**

104

**SELECTING ONE OR TWO HEAT EXCHANGER
CONNECTED WITH PIPES**

106

**BONDING HEAT PIPE THERMAL PLANE AND
HEAT EXCHANGERS TO COLD PLATE BASE**

FIG. 3